

# Room Transmitter Design 0-10 V

**Article number: 801110 6013**

Our room transmitter has a 0-10 V voltage output and can be mounted using screws. The Design 0-10 V room transmitter has eight switchable measuring ranges, a Frija 1 housing made of plastic and is suitable for measuring the temperature in indoor areas such as offices, supermarkets and schools.



## Supply and output

Output	0 - 10 V
Power consumption	< 1,0 VA / 24 V DC; < 2,2 VA / 24 V AC
Voltage supply	24 V AC / DC ( $\pm 10 \%$ )
Connection type	3-Wire

## General information

Measuring range	multi-range switching with 8 switchable measuring ranges Operating range: -30 °C to 70 °C with manual zero point correction ( $\pm 10$ K)
Sensor	Pt1000, DIN EN 60751, Class B
Temperature deviation	typically $\pm 0.2$ K at +25 °C
Load resistance	RI > 5 kOhm
Process connection	by screws

## Housing

Material	not specified Material ABS
Dimensions (L/W/H) (mm)	91 x 85 x 27
Color	not specified
Electrical connection	0.14 - 1.5 mm <sup>2</sup> , via screw terminals on circuit board

## Ambient conditions

Ambient temperature	-30 °C to +70 °C
Permissible air humidity	< 95 % r. H., non-precipitating air

## Certifications / Standards

Protection class	III (nach EN 60 730)
Protection type	IP 30 according to EN 60 529
Standards	CE conformity electromagnetic compatibility according to EN 61326 according to EMC Directive 2014/ 30/ EU

MW / CK / 16.01.2024

## Testo Sensor GmbH

Testo-Straße 1  
D-79853 Lenzkirch

+49 7653 96597-0  
+49 7653 96597-99

info@testo-sensor.de  
www.testo-sensor.de


Unser Standard-Portfolio finden Sie in unserem  
Webshop unter: [www.testo-sensor.shop](http://www.testo-sensor.shop)

**Delivery and Packing**

Delivery	Transmitter, Operating instructions
Packing	individually packed in cardboard box
Article number	801110 6013

**Technical drawing**


All dimensions in mm

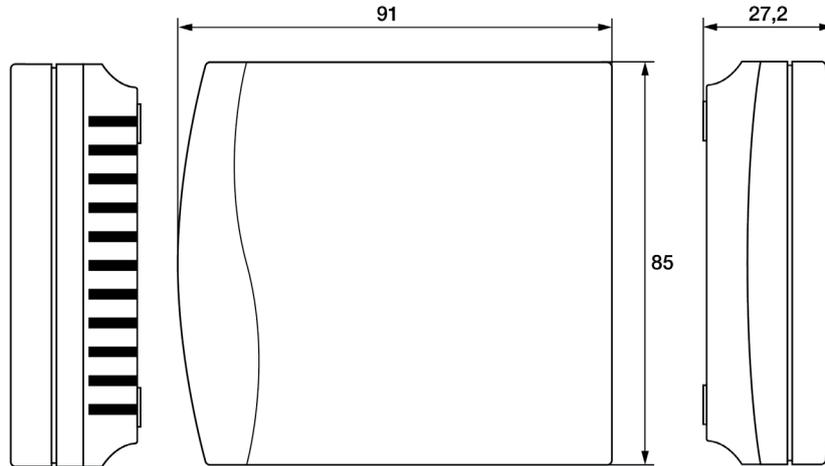



**Important assembly instructions**

For an accurate measurement of the room temperature, it is important to consider the temperature dynamics in the room. Air circulation should only take place through the openings in the housing cover. Therefore, the transmitter should be installed away from objects or obstacles that shield air movement. Please also be sure to avoid uncontrolled air currents (draughts) by installing near doors or windows. In addition, the transmitter should not be mounted on the colder outside wall.

Wall mounting or on flush-mounted box, Ø 55 mm, bottom part with 4-hole, for mounting on vertically or horizontally installed flush-mounted boxes for cable entry at the rear, with predetermined breaking point for cable entry at the top/ bottom for surface-mounted units.


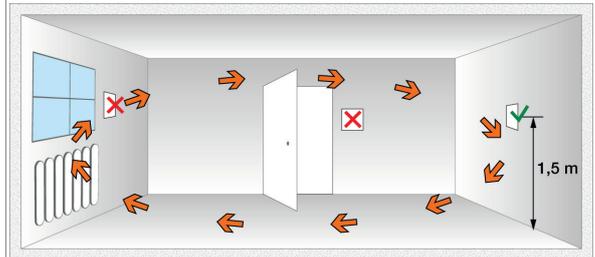


**Drilling template**

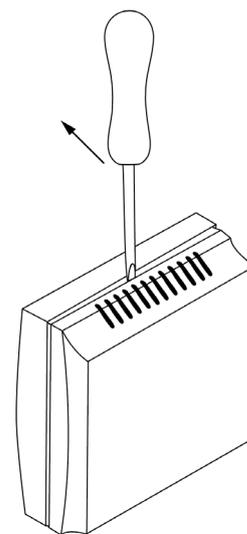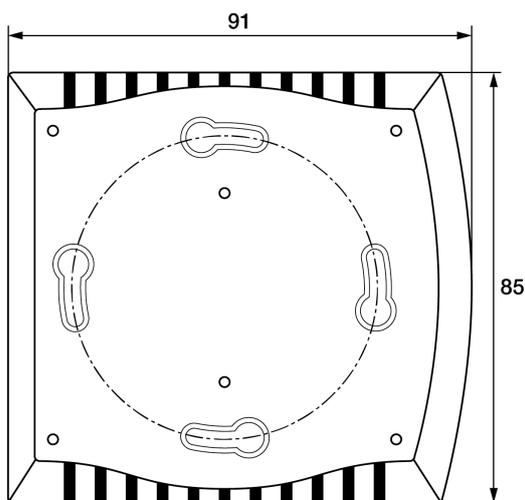

MW / CK / 16.01.2024

**Circuit diagrams and assignment (Please also read the operating instructions before connecting the transmitter)**

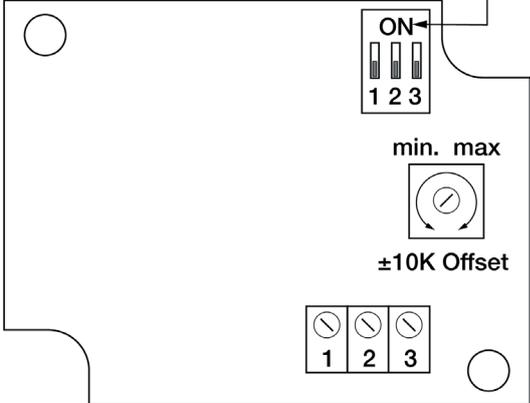Wiring diagram	Assignment	Set scaling via DIP switch																																				
<p><b>DIP-Schalter Messbereichumschaltung</b>  <b>DIP switches Measuring range changeover</b></p> 	<p>1 = +UB 24 V AC/DC</p> <p>2 = Output temperature 0-10 V (°C)</p> <p>3 = -UB GND</p> <p><b>Default configuration</b></p> <p>Werkseinstellungen: Skalierung: 0 .. 50 °C</p> 	<p>Messbereichumschaltung via DIP-Schalter                  Changing measuring range via DIP switches</p> <table border="1"> <thead> <tr> <th>DIP 1</th> <th>DIP 2</th> <th>DIP 3</th> <th>Scaling Range</th> </tr> </thead> <tbody> <tr> <td>on</td> <td>on</td> <td>on</td> <td>-20 .. +150°C</td> </tr> <tr> <td>off</td> <td>on</td> <td>on</td> <td>-50 .. +50°C</td> </tr> <tr> <td>on</td> <td>off</td> <td>on</td> <td>-20 .. +80°C</td> </tr> <tr> <td>off</td> <td>off</td> <td>on</td> <td>-30 .. +60°C</td> </tr> <tr> <td>on</td> <td>on</td> <td>off</td> <td>0 .. +40°C</td> </tr> <tr> <td>off</td> <td>on</td> <td>off</td> <td>0 .. +50°C</td> </tr> <tr> <td>on</td> <td>off</td> <td>off</td> <td>0 .. +100°C</td> </tr> <tr> <td>off</td> <td>off</td> <td>off</td> <td>0 .. +150°C</td> </tr> </tbody> </table>	DIP 1	DIP 2	DIP 3	Scaling Range	on	on	on	-20 .. +150°C	off	on	on	-50 .. +50°C	on	off	on	-20 .. +80°C	off	off	on	-30 .. +60°C	on	on	off	0 .. +40°C	off	on	off	0 .. +50°C	on	off	off	0 .. +100°C	off	off	off	0 .. +150°C
DIP 1	DIP 2	DIP 3	Scaling Range																																			
on	on	on	-20 .. +150°C																																			
off	on	on	-50 .. +50°C																																			
on	off	on	-20 .. +80°C																																			
off	off	on	-30 .. +60°C																																			
on	on	off	0 .. +40°C																																			
off	on	off	0 .. +50°C																																			
on	off	off	0 .. +100°C																																			
off	off	off	0 .. +150°C																																			

MW / CK / 16.01.2024

**Testo Sensor GmbH**

Testo-Straße 1  
D-79853 Lenzkirch

+49 7653 96597-0  
+49 7653 96597-99

info@testo-sensor.de  
www.testo-sensor.de

Unser Standard-Portfolio finden Sie in unserem  
Webshop unter: [www.testo-sensor.shop](http://www.testo-sensor.shop)